



English



CE
0158

Installation and Operating Manual

Universal display for
4-20mA or 0-10V - transmitter

GIA 010 N - ex
GIA 0420 N - ex



WEEE-Reg.-Nr. DE 93889386



Senseca Germany GmbH
Tenter Weg 2-8 | 42897 Remscheid | GERMANY
Tel.: +49 2191 9672-0 | info@senseca.com | www.senseca.com

Index

1	GENERAL NOTE	2
2	DESIGNATED USE	3
2.1	INTENDED USE	3
2.2	SAFETY SIGNS AND SYMBOLS	3
2.3	SKILLED PERSONNEL	3
2.4	SAFETY GUIDELINES	4
2.5	EX PROTECTION	5
3	PRODUCT DESCRIPTION	5
3.1	SCOPE OF SUPPLY	5
3.2	FUNCTION DESCRIPTION	5
3.3	IDENTIFICATION	6
3.4	MOUNTING IN PANELS / HOUSINGS	6
3.5	DISPLAY AND OPERATING ELEMENTS	7
4	ELECTRIC CONNECTION	7
4.1	TERMINAL ASSIGNMENT	7
4.1.1	Connection example for optionally switching output	8
4.1.2	GIA 0420 N - ex: Switching of a alarm device	8
4.1.3	GIA 010 N - ex: Switching of a alarm device	8
5	CONFIGURATION	9
6	SELECTION OF SWITCHING AND ALARM POINTS	11
7	OFFSET AND SLOPE ADJUSTMENT	12
8	MIN-/MAX- VALUE MEMORY	12
9	ERROR CODES	13
10	SPECIFICATIONS	14
11	DECOMMISSIONING, RESHIPMENT AND DISPOSAL	15
11.1	RESHIPMENT	15
11.2	DISPOSAL INSTRUCTIONS	15
ADDENDUM A: EC – DECLARATION OF CONFORMITY		16
ADDENDUM B: EC-TYPE EXAMINATION CERTIFICATE		17

1 General note

Read this document carefully and get used to the operation of the device before you use it. Keep this document within easy reach near the device for consulting in case of doubt.

2 Designated Use

2.1 Intended Use

The GIA 0420 N - ex and GIA 040 10 - ex are microprocessor controlled display devices for 4..20 ma or 0..10V input signals.

The device is suitable for use in potentially explosive atmospheres of group II, zone 1 and 2, temperature class T4 to T1 (according to IEC 60079-0).

The device must not be used in hazardous areas other than those mentioned above, in particular not in underground mines as well as in potentially explosive dust atmospheres. It should also be noted that the device is not suitable for applications which require the temperature classes T6 or T5.

The GIA ... N - ex have a electrically isolated switching output. The output switch and the switching device must be supplied from the same intrinsically safe circuit as the display GIA ... N - ex.

The device may only be operated in combination with Ex-approved transmitters and intrinsically safe circuits in accordance with the connection data. The total capacitance and inductance of device GIA ... N - ex, intrinsically safe transmitter, switching devices and wiring may not exceed the allowable for the intrinsically safe circuit totals.

If the GIA ... N - ex was operated on non-intrinsic circuits or if the permissible load values were exceeded, the device must not be used again in Ex applications.

The device GIA ... N - ex meet the requirements of intrinsic safety only after it is built in an appropriate device, which conforms with the necessary IP protection degree.

Only technically qualified persons are permitted to carry out installation, commissioning, operation and decommissioning. The qualified personnel must have carefully read and understood the operating manual before beginning any work.

The liability and warranty of the manufacturer for damages and consequential damages are voided with misuse, disregard of this operating manual, assignment of inadequately qualified technical personnel and arbitrary modifications of the product.

2.2 Safety signs and symbols

Warnings are labelled in this document with the followings signs:



Caution!

This symbol warns of imminent danger, death, serious injuries and significant damage to property at non-observance



Caution!

This symbol indicates a potentially dangerous situation in explosion-prone areas that can result in death or severe injuries if it is not avoided.



Attention!

This symbol warns of possible dangers or dangerous situations which can provoke damage to the device or environment at non-observance.



Note!

This symbol point out processes which can indirectly influence operation or provoke unforeseen reactions at non-observance.









2.3 Skilled personnel

are persons who are familiar with the set-up, installation, commissioning and operation of the product and have appropriate qualification for their work. For example:

- Training or instruction and/or authorisation, power circuits and devices/systems in accordance with the standards of safety for activation, deactivation, disconnection, earthing and identification.
- Training or instruction in accordance with the standard of safety technology for care and use of suitable safety equipment.
- Knowledge about the installation of devices in explosion-prone areas.

2.4 Safety guidelines

This device has been designed and tested in accordance with the safety regulations for electronic devices. However, its trouble-free operation and reliability cannot be guaranteed unless the standard safety measures and special safety advises given in this manual will be adhered to when using the device.

1.  Requirements of Directive 2014/34/EU (ATEX) and IECEx must be observed
The respective national regulations for Ex use must also be complied with (e.g. EN 60079-10 and EN 60079-14).
2.  Install the displaying device according to the manufacturer's specifications and the valid standards and regulations.
3.  The device may be connected to approved intrinsically safe circuits with his maximum values.
4.  For units with optional output switch, the output switch and the switching device must be supplied from the same intrinsically sage circuit as the GIA ...!
Only approved intrinsically safe switching devices may be used which correspond to the specified maximum values of the circuit. The total capacitance and inductance of the devices GIA ... (incl. switching output) and the switching devices, including the connection cable values, may not exceed the allowable for the intrinsically safe circuit totals. If concentrated inductances and capacitances exist, the manufacturer must be consulted for permission.
5.  Modifications or repairs of the device may not be performed by the customer.
For maintenance or repair the device must be sent to the manufacturer.
6.  The opening of the devices is only permitted outside the hazardous area.
7.  The device GIA ... N – ex meet the requirements of intrinsic safety only after it is built in an appropriate device, which conforms with the necessary IP protection degree.
8.  The device must not be configured at Ex area!



Trouble-free operation and reliability of the device can only be guaranteed if the device is not subjected to any other climatic conditions than those stated under "Specification".



When connecting the device to other devices (e.g. PC) the interconnection has to be designed most thoroughly as internal connections in third-party devices (e.g. connection GND with protective earth) may lead to undesired voltage potentials.



If there is a risk whatsoever involved in running it, the device has to be switched off immediately and to be marked accordingly to avoid re-starting.

Operator safety may be a risk if:

- there is visible damage to the device.
- the device is not working as specified.
- the device has been stored under unsuitable conditions for a longer time.

In case of doubt, please return device to manufacturer for repair or maintenance.



Do not use these products as safety or emergency stop devices or in any other application where failure of the product could result in personal injury or material damage.

Failure to comply with these instructions could result in death or serious injury and material damage.

2.5 Ex protection

1. The device may be connected to approved intrinsically safe circuits with the following maximum values:

GIA 0420 N - ex:

$U_i = 28 \text{ V DC}$
 $I_i = 100 \text{ mA}$
 $P_i = 1.2 \text{ W}$
 $C_i \leq 13 \text{ nF}$
 $L_i = \sim 0 \text{ }\mu\text{H}$

GIA 010 N - ex:

$U_i = 28 \text{ V DC}$
 $I_i = 100 \text{ mA}$
 $P_i = 0.95 \text{ W}$
 $C_i \leq 26 \text{ nF}$
 $L_i = \sim 0 \text{ }\mu\text{H}$

Additional for the switching output (only at option "switching output")

$C_i \leq 4.5 \text{ nF}$
 $L_i = \sim 0 \text{ }\mu\text{H}$

$C_i \leq 4.5 \text{ nF}$
 $L_i = \sim 0 \text{ }\mu\text{H}$

3 Product description

3.1 Scope of supply

- display device
- 1 VA spring clip
- screw-in/plug-in clamps (according to the model)
- mounting and operating manual

3.2 Function description

The GIA 0420 N - ex and GIA 010 N - ex are microprocessor controlled display devices.

The different design types of the device have an input for:

- standard signal 4 – 20 mA (GIA 0420 N - ex)
- standard signal 0 – 10 V (GIA 010 N - ex)

The measuring value is displayed on a 4-digit LCD display with max. display area ranging from -1999 to +9999 digits.

The device additionally features a switching output (NPN-output) which can be configured as 2-point controller or min-/max alarm. The state of the output is displayed with an arrow at the LCD.

The GIA 0420 ... is designed for the connection of any measuring transducers (with a 4 to 20 mA output). This design type doesn't need an auxiliary supply as it is supplied by the measuring current.

The GIA 010 ... is designed for the connection of any measuring transducers (with a 0 - 10 V output).

The parameters and limit values can be input by buttons accessible at the rear side.

The operating range of the display device can be directly adjusted to the transmitter without any additional accessories by simply entering the maximum and minimum measuring range limits as well as the decimal point position.

All programmable parameters of the device are saved in an EEPROM. In case of a current failure they will remain there for at least 10 years.


The device is equipped with a self-diagnosis system continuously monitoring the essential parts of the device for their perfect functioning. Both the self-diagnosis and the measuring sensor monitoring for values exceeding or falling below permissible limits ensure maximum operational reliability of the device.

Prior to delivery the device will be tested and completely calibrated.

However, prior to you starting your operation make sure to configure the device for your application. Please also refer to chapter "Configuration".


3.3 Identification

Examples for device printing and type plate:

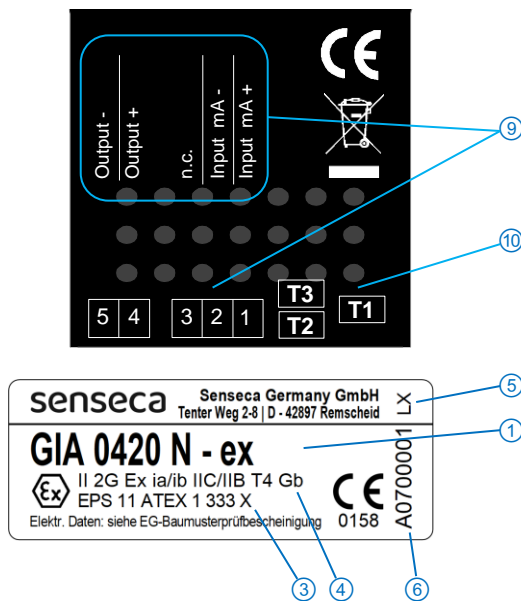


3.4 Mounting in panels / housings



Panel cut-out:

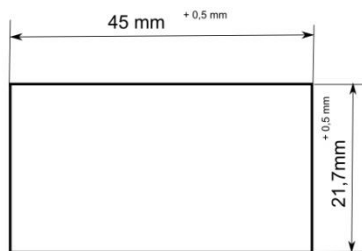

Mounting:

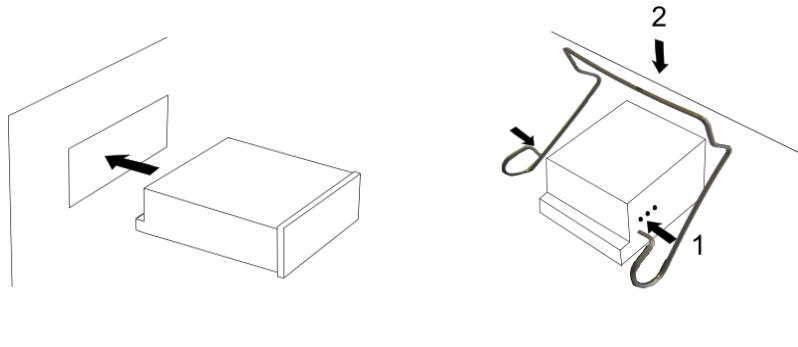

3.5 Display and operating elements

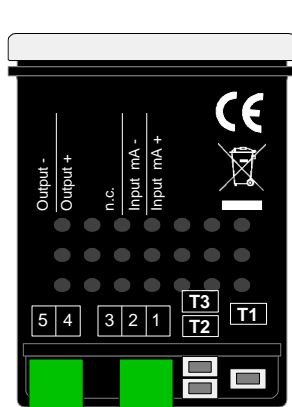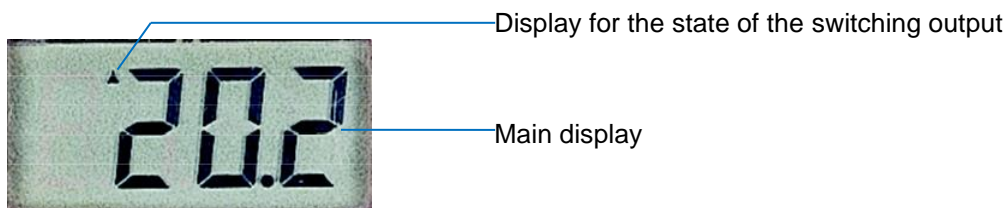

Button 1, >2s:

activates menu "switching points ..." (refer to chap. 6)

In menu:

save value or step to next parameter



Button 2, short

display max. value

Button 2, >2s:

activates configuration menu (refer to chapter 5)

Button 2 + 3, >2s:

reset min-/max. value

In menu: press short= increase value.

press long = roll-function with overflow-function.*)



Button 3, short

display min. value

Button 2, >2s:

activates offset/slope menu " (refer to chapter 7)

Button 2 + 3, >2s:

reset min-/max. value

In menu: press short= increase value.

press long = roll-function with overflow-function.*)

*) The input is made with the buttons 2 and 3. When pressing the button once the value will be raised (button 2) by one or lowered (button 3) by one.

When holding the button pressed for longer than 1 sec. the value starts counting up or down, the counting speed will be raised after a short period of time.

The device also features a 'overflow-function', when reaching the upper limit of the range, the device switches to the lower limit, vice versa.

4 Electric connection

The GIA ... N – ex is connected via screw-type/plug-in terminals on the rear side.

General Note: Screw-type/plug-in terminals have to be mounted while they are still loose and plug them in only afterwards. Soldering lands may be damaged in case of improper assembly of already plugged terminals.

Please use applicable screwdriver and do not forcibly tighten the screws.

Supply voltage: GIA 0420 N - ex device takes power from measuring current
GIA 010 N - ex 12 ... 28 V or according device declaration

Electric connection and commissioning of the device must be carried out by trained and skilled personnel.


Wrong connection may lead to the destruction of the display device, in which case we cannot assume any warranty!

! Mind for the GIA 0420 ... - ex the maximum input current rating of 40mA under any circumstances !


4.1 Terminal assignment

connection number	GIA 0420 N - ex	GIA 010 N - ex
1	signal +	supply +
2	signal -	supply -, GND
3	--- (inexistent)	signal +
4	switching output +	switching output +
5	switching output -	switching output -

GIA 0420 N - ex

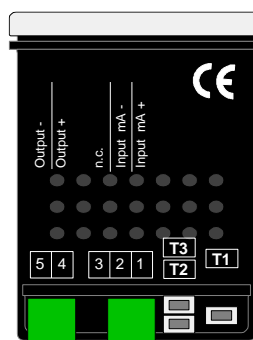

GIA 010 N - ex

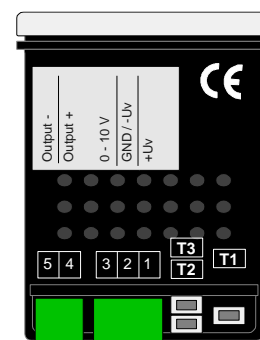

4.1.1 Connection example for optionally switching output

Please note: The max. permitted voltage and switching current of the switching output must not be exceeded (even not for a short time).


Attention: The measuring and switching branches have to be supplied by the same intrinsically safe current circuit. The total capacity and inductivity of GIA..., intrinsically safe transducer, intrinsically safe switching device and cabling have to meet the limit values of the supply device!

Example for permitted connection values of switching devices/cabling if the universal isolating amplifier **ST 500 Ex - 10 - ..** and the 4-20mA transducer **IS-20 S** or **GITT 01 - ex** is used:


Connection values of the ST 500 for ia/IIC: $C_o = 47 \text{ nF}$, $L_o = 2 \text{ mH}$
for ia/IIB: $C_o = 370 \text{ nF}$, $L_o = 15 \text{ mH}$

	Pressure transmitter IS-20 S	Temperature transmitter GITT 01 - ex
Connection values transmitter:	$C_i < 22 \text{ nF}$, $L_i = 0 \text{ mH}$	$C_i = 0 \text{ nF}$, $L_i = 0 \text{ mH}$
Remaining values for switching device/cabling if GIA 0420 is used:	for ia/IIC: $C_i < 7.5 \text{ nF}$ ($47 \text{ nF} - (13 + 4.5 + 22) \text{ nF}$) $L_i < 2 \text{ mH}$ ($2 \text{ mH} - (0 + 0) \text{ mH}$) for ia/IIB: $C_i < 330 \text{ nF}$ ($370 \text{ nF} - (13 + 4.5 + 22) \text{ nF}$) $L_i < 15 \text{ mH}$ ($15 \text{ mH} - (0 + 0) \text{ mH}$)	for ia/IIC: $C_i < 29.5 \text{ nF}$ ($47 \text{ nF} - (13 + 4.5 + 0) \text{ nF}$) $L_i < 2 \text{ mH}$ ($2 \text{ mH} - (0 + 0) \text{ mH}$) for ia/IIB: $C_i < 352 \text{ nF}$ ($370 \text{ nF} - (13 + 4.5 + 0) \text{ nF}$) $L_i < 15 \text{ mH}$ ($15 \text{ mH} - (0 + 0) \text{ mH}$)
Remaining values for switching device/cabling if GIA 010 is used:	for ia/IIC: connection is not allowed!! ($C_o = 47 \text{ nF} < (26 + 4.5 + 22) \text{ nF}$) for ia/IIB: $C_i < 317 \text{ nF}$ ($370 \text{ nF} - (26 + 4.5 + 22) \text{ nF}$) $L_i < 15 \text{ mH}$ ($15 \text{ mH} - (0 + 0) \text{ mH}$)	

4.1.2 GIA 0420 N - ex: Switching of a alarm device

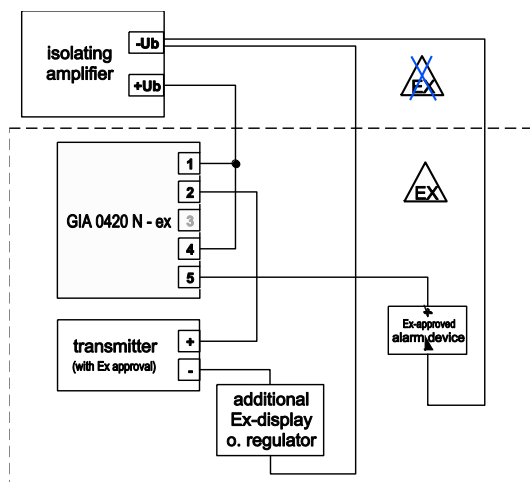

4.1.3 GIA 010 N - ex: Switching of a alarm device

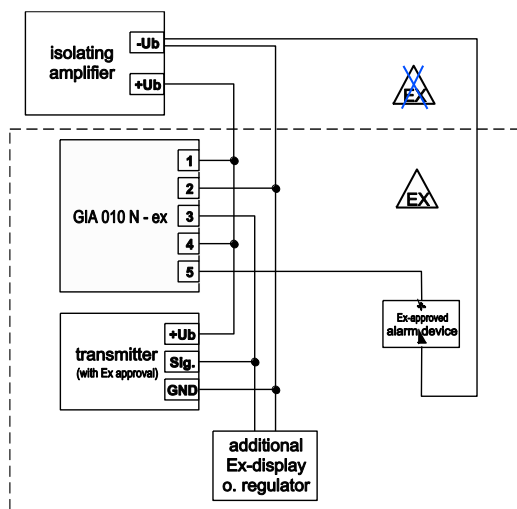


5 Configuration

Note: The device can be ESD sensitive at the area of the buttons.
The configuration must be done considering adequate ESD safety measures!
!!! Keep in mind: The device must not be configured at Ex area !!!

Please note: measuring current should be at least 4mA during configuration of a GIA 0420 N - ex!

Follow these instructions to configure the device:

- Press **button 2** for 2 seconds during actual value display, „dP“ is displayed.
- Set parameter value with **button 2** and **button 3**.
- Save the set with **button 1**, the parameter name is displayed again.
- Proceed to the next parameter with **button 1**, the name of that parameter is displayed.

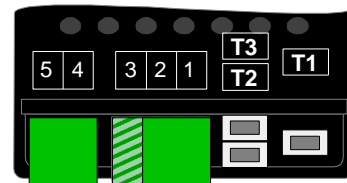

If there is no key pressed within 60 seconds the configuration is cancelled.
The settings already entered are lost.

Parameter	Value	Description
Button 1	Button 2 and 3	
dP	Position of decimal point	
	----	Max. display range: -1999 ... 9999
	---.-	Max. display range: -199,9 ... 999,9
	--.---	Max. display range: -19,99 ... 99,99
	-.---	Max. display range: -1,999 ... 9,999
di Lo	Lower display range limit (display low)	
	-1999 ... 9999	This value is displayed for input signal = 4 mA or 0 V.
di Hi	Upper display range limit (display high)	
	-1999 ... 9999	This value is displayed for input signal = 20 mA or 10 V.
L	(Measuring range) limit	
	oFF	deactivated: Exceeding of the measuring range limit is tolerable as long as value is within measuring range (p.r.t. note).
	on.Er	active, (display error): The measuring range limit is exactly bounded by the input signal. When exceeding or short falling the input signal the device will display an error message.
	on.rG	active, (display measuring range limit): The measuring range limit is exactly bounded by the input signal. When exceeding or short-falling the input signal the device will display the selected lower/upper display value. <i>e.g. humidity: when shortfalling or exceeding, the device will display 0% or 100%.</i>
	Note: When exceeding the measuring range, the device will always display an error message (.Err.1. or .Err.2.) independent of the current limit settings. The measuring range is from approx 3,7 and 20,8 mA respective 10.5 V (a falling below 0V will not be detected).	
Filt	Filter	
	oFF	Filter deactivated
	0.1 ... 2.0	Filter active: Prevents “jumping” of the last digit and filters short noise pulses. Higher numbers imply stronger filtering <i>Attention: this causes higher response times of the switching functions!</i>

outP	Output function	
	no	No output, device used as display
	2P	2-point-controller
	ALFI	Min- / max- alarm, together

Depending on the selected output function further parameters have to be adjusted. The configuration menu automatically skips parameters not needed for the selected output function. The following diagram shows which parameters are successively displayed for each output function.

A description of the single parameters follows afterwards.

Parameter	Value	Description
Button 1	Button 2 and 3	
1.on only at outP = 2P	Switch-on point of output 1	
	d1.Lo ... d1.Hi	Value at which output 1 should be switched on. Value has to be between upper and lower measuring range limit set at the beginning of the configuration menu.
1.off only at outP = 2P	Switch-off point of output 1	
	d1.Lo ... d1.Hi	Value at which output 1 should be switched off. Value has to be between upper and lower measuring range limit set at the beginning of the configuration menu.
1.dEL only at outP = 2P	Delay of switching function of output 1	
	0.0 ... 999.9	The set value is the time [in seconds] the device waits at least after switching-off output 1 to switch it on again.
1.Err only at outP = 2P	Preferred position of output 1	
	on, off	If an error occurs, the device switches output 1 to “active” (on) or “inactive” (off)
ALHi only at outP = A / I	Max-alarm point	
	ALLo ... d1.Hi	Value, at which max-alarm should be triggered. Value has to be between upper and lower measuring range limit set at the beginning of the configuration menu.
ALLo only at outP = A / I	Min-alarm point	
	d1.Lo ... ALHi	Value, at which min-alarm should be triggered. Value has to be between upper and lower measuring range limit set at the beginning of the configuration menu.
A.dEL only at outP = A / I	Alarm delay	
	0 ... 9999	The set value is the alarm delay in seconds. The alarm case has to last for the set time to trigger the alarm.

After having set and confirmed the last point (depending on the selected output function) the configuration is done.

Press **button 1** one more time after the input of the last parameter to close the configuration menu.

The device restarts (segment test).

6 Selection of switching and alarm points


Note: *The device can be ESD sensitive at the area of the buttons.
The configuration must be done considering adequate ESD safety measures!
!!! Keep in mind: The device must not be configured at Ex area !!!*

Note: All relevant switching and alarm points can be set at this menu.
(Preferred output position and delay of the output can only be set at configuration menu)
Depending on the selected output function different parameters have to be adjusted.
The configuration menu automatically skips parameters not needed for the selected output function.

Note: *The menu cannot be called if output function is set off.*

Follow these instructions to adjust switching and alarm points:

- Press **button 1** for 2 seconds during actual value display, „1.on“ or „AL.Hi“ is displayed.
- Set parameter value with **button 2** and **button 3**.
- Save the set with **button 1**, the parameter name is displayed again.
- Proceed to the next parameter with **button 1**, the name of that parameter is displayed.

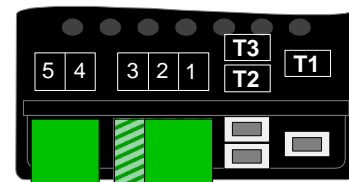

*If there is no key pressed within 60 seconds the configuration is cancelled.
The settings already entered are lost.*

Parameter	Value	Description
Button 1	Button 2 and 3	
1.on only at outP = zP	Switch-on point of output 1	
	d _i .Lo ... d _i .Hi	Value at which output 1 should be switched on. Value has to be between upper and lower measuring range limit set at the beginning of the configuration menu.
1.off only at outP = zP	Switch-off point of output 1	
	d _i .Lo ... d _i .Hi	Value at which output 1 should be switched off. Value has to be between upper and lower measuring range limit set at the beginning of the configuration menu.
AL.Hi only at outP = A	Max-alarm point	
	ALLo ... d _i .Hi	Value, at which max-alarm should be triggered. Value has to be between upper and lower measuring range limit set at the beginning of the configuration menu.
AL.Lo only at outP = A	Min-alarm point	
	d _i .Lo ... ALHi	Value, at which min-alarm should be triggered. Value has to be between upper and lower measuring range limit set at the beginning of the configuration menu.
A.del only at outP = A	Alarm delay	
	0 ... 9999	The set value is the alarm delay in seconds. The alarm case has to last for the set time to trigger the alarm.

After having set and confirmed the last point (depending on the selected output function) the configuration is done.

Press **button 1** one more time after the input of the last parameter to close the configuration menu. The devices re-starts (segment test).


7 Offset and slope adjustment

Note: *The device can be ESD sensitive at the area of the buttons.
The configuration must be done considering adequate ESD safety measures!
!!! Keep in mind: The device must not be configured at Ex area !!!*

The offset and slope-adjustment function can be used for compensating the tolerance of the used sensor, resp. for vernier adjustment of the used transducer / transmitter.

Follow these instructions to run the offset and slope adjustment of the device:

- Press **button 3** for 2 seconds during actual value display, „OFFS“ is displayed.
- Set parameter value with **button 2** and **button 3**.
- Save the set with **button 1**, the parameter name is displayed again.
- Proceed to the next parameter with **button 1**, the name of that parameter is displayed.

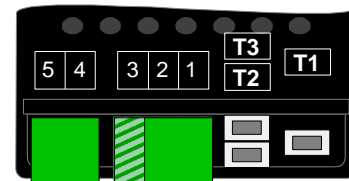

Parameter	Value	Description
Button 1	Button 2 and 3	
OFFS	Offset	
	-5.00 ... 5.00	The offset in digit The set offset value is subtracted from measured value.
ScAL	Scale	
	-5.00 ... 5.00	The scale in %. The displayed value is calculated according to the following formula: Display = (measured value - offset - di.Lo) * (1 + slope adjustment [% / 100]) + di.Lo

Example for offset and slope adjustment:

Connection of pressure transmitter.

The device displays without offset and slope adjustment: at 0 bar = 0.08, at 20 bar = 20.02

From this calculated:

offset:	0.08
slope:	$20.02 - 0.08 = 19.94$
difference:	$0.06 \quad (= \text{ideal slope} - \text{actual slope} = 20.00 - 19.94)$

Therefore this values should be set:

offset =	0.08
scale =	$0.30 \quad (= \text{difference} / \text{actual slope} = 0.06 / 19.94 = 0.0030 = 0.30\%)$

8 Min-/max- value memory

The device features a minimum/maximum-value storage. In this storage the highest and lowest performance data is saved.

Calling of the minimum value:

Press button 3 shortly: the device will display “Lo” briefly, after that the min-value is displayed for about 2 sec.

Calling of the maximum value:

Press button 2 shortly: the device will display “Hi” briefly, after that the max-value is displayed for about 2 sec.

Erasing of the min/max values:

Press button 2 and 3 for 2 sec.: The device will display “CLr” briefly, after that the min/max-values are set to the current displayed value.

9 Error Codes

When detecting an operating state which is not permissible, the device will display an error code.
The following error codes are defined:

Err.1: Exceeding of measuring range

Indicates that the valid measuring range of the device has been exceeded.

Possible causes:

- Input signal to high
- Sensor shorted (at 0(4)-20mA)

Remedies:

- The error-message will be reset if the input signal is within the limits.
- Check transmitter and device configuration (e.g. input signal).

Err.2: Values below measuring range

Indicates that the values are below the valid measuring range of the device.

Possible causes:

- Input signal is to low or negative
- Current below 4mA
- Sensor broken (at 4-20mA)

Remedies:

- The error-message will be reset if the input signal is within the limits.
- Check transmitter and device configuration (e.g. input signal).

Err.3: Display range has been exceeded

Indicates that the valid display range (9999 digit) of the device has been exceeded.

Possible causes:

- Incorrect scale

Remedies:

- The error-message will be reset if the display value is below 9999.

Err.4: Values below display range

Indicates that display value is below the valid display range of the device (-1999 digit).

Possible causes:

- Incorrect scale

Remedies:

- The error-message will be reset if the display value is above -1999.

Err.7: System error

The device features an integrated self-diagnostic-function which checks essential parts of the device permanently. When detecting a failure, error-message Err.7 will be displayed.

Possible causes:

- Actual temperature is below / above the valid temperature range
- Device defective

Remedies:

- Stay within valid temperature range
- Exchange the defective device.

Er.11: Value could not be calculated

Indicates a measuring value, needed for calculation of the display value, is faulty or out of range.

Possible causes:

- Incorrect scale

Remedies:

- Check settings and input signal

10 Specifications

	GIA 0420 ... - ex	GIA 010 ... - ex
Input signal:	4 ... 20 mA (2-wire)	0 ... 10V (3-wire)
Voltage load:	3.0 – 3.5 V (typ.)	
Input resistance:		approx. 100 kOhm
max. permissible input:	25 mA (40mA short time)	15 V
Supply voltage:		12 - 28 V
Supply current:	from current loop	< 10 mA
Display:	approx. 10 mm high LCD-display	
Display range:	limits freely adjustable	
Max. display value:	9999 digit	
Min. display value:	-1999 digit	
Recommended range:	≤ 2000 digit	
Decimal point:	any position	
Accuracy: (at 25°C)	< 0.2% ±1 digit	
Temperature drift:	< 100 ppm / K	
Measuring rate:	approx. 5 measurements / second	
Filter:	adjustable	
Operation:	via 3 buttons	
Min-/max-value memory:	callable via buttons	
Switching output:	1 electrically isolated open collector output, Test voltage: 50 V	
Switching point, hysteresis:	freely adjustable	
Switching voltage:	max. 28 V	
Switching current:	max. 50 mA <i>Please note: the switching output is not short-circuits protected</i>	
Reaction time:	≤ 250 ms	
Nominal temperature:	25 °C	
Working conditions:	-20 ... 50 °C, 0 ... 80 % (non condensing)	
Connection:	via 2- or 3-pin screw-type/plug-in terminal max. wire cross section: 1.5 mm ²	
Housing:	glass fibre reinforced noryl, front panel PC 24 x 48 x approx. 65 mm (H x W x D)	
Panel cut-out:	21.7 ^{+0.5} x 45 ^{+0.5} mm (H x W)	
IP rating:	IP20 by front-flush mounting: front side IP54 (IP65 by means of additional silicone o-rings)	
Directives and standards:	The instruments confirm to following European Directives: 2014/34/EU ATEX Directive 2014/30/EU EMC Directive 2011/65/EU RoHS Applied harmonized standards: EN IEC 63000 : 2018 EN IEC 60079-0 : 2018 EN 60079-11 : 2012 EN 61326-1 : 2013 emissions level: class B emi immunity according to table 2 Additional fault: <1 % <i>When connecting long leads adequate measures against voltage surges have to be taken.</i> <i>The device is ESD sensitive at the area of the buttons at the rear side.</i>	

Ex protection:**Ex II 2 G Ex ia IIC T4**

EC-Type Examination Certificate: BVS 11 ATEX 1 333 X

Connection data: U_{max}: 28 VI_{max}: 100 mAP_{max}: 1.2 W (for GIA 0420 N - ex) or 0.95 W (for GIA 010 N - ex)Max. effective internal capacitance: C_i = 13 nF (for GIA 0420 ...) or 26 nF (for GIA 010 ...)
additional for the switching output: C_i = 4.5 nF

Maximum effective internal inductance of the device are negligibly small

When making connections to the switching output the connections must be within the same intrinsically safe circuit like the measuring signal!

11 Decommissioning, reshipment and disposal

11.1 Reshipment



All devices returned to the manufacturer have to be free of any residual of measuring media and other hazardous substances. Measuring residuals at housing or probe may be a risk for persons or environment.



Use an adequate transport package for reshipment, especially for fully functional devices. Please make sure that the device is protected in the package by enough packing materials.

11.2 Disposal instructions



The device must not be disposed in the unsorted municipal waste!
Send the device directly to us (sufficiently stamped), if it should be disposed.
We will dispose the device appropriate and environmentally sound.

Addendum A: EC – Declaration of Conformity



EU-KONFORMITÄTSERKLÄRUNG EU-DECLARATION OF CONFORMITY



Senseca | Senseca Germany GmbH | Tenter Weg 2-8 | 42897 Remscheid | GERMANY

Dokument-Nr. / Monat.Jahr: **1037 / 01.2024**
Document-No. / Month.Year:

Wir erklären hiermit unter alleiniger Verantwortung, dass die folgenden Produkte konform sind mit den Schutzziele der Richtlinie des Europäischen Parlaments:
We declare herewith under our sole responsibility that the following products are in compliance with the protection requirements defined in the European Council directives:

Produktbezeichnung: **GIA 0420 N - ex, GIA 010 N - ex**
Product identifier:

Produktbeschreibung: **Universal-Einbauanzeige**
Product description: **Universal built-in displaying device**

Die Produkte entsprechen den folgenden Europäischen Richtlinien:
The products conforms to following European Directives:

Richtlinien / <i>Directives</i>	
2014/30/EU	EMV Richtlinie / <i>EMC Directive</i>
2014/34/EU	ATEX / <i>ATEX</i>
2011/65/EU	RoHS / <i>RoHS</i>

Angewandte harmonisierte Normen oder angeführte technische Normen:
Applied harmonized standards or mentioned technical specifications:

Harmonisierte Normen / <i>harmonized standards</i>	
EN 61326-1 : 2013	Allgemeine EMV Anforderungen / <i>General EMC requirements</i>
EN IEC 60079-0 : 2018	Allgemeine ATEX Anforderungen / <i>General ATEX requirements</i>
EN 60079-11 : 2012	Geräteschutz durch Eigensicherheit "i" / <i>Protection by intrinsic safety "i"</i>
EN IEC 63000 : 2018	Beschränkung der gefährlichen Stoffe / <i>Restriction of hazardous substances</i>

EG-Baumusterprüfbescheinigung / ausgestellt von: **EPS 11 ATEX 1 333 X** / Bureau Veritas Consumer Products Services Germany GmbH (Reg.No. 2004)

Qualitätssicherung / *quality assurance:* DEKRA Testing and Certification GmbH (Reg.No. 0158)

Diese Erklärung wird verantwortlich für den Hersteller abgegeben durch:
The manufacturer is responsible for the declaration released by:

Walter Vogelsberger
Forschungs- und Entwicklungsleiter
Senior Director Research & Development

Remscheid, 2. Januar 2024

Diese Erklärung bescheinigt die Übereinstimmung mit den genannten Harmonisierungsrechtsvorschriften, beinhaltet jedoch keine Zusicherung von Eigenschaften.
This declaration certifies the agreement with the harmonization legislation mentioned, contained however no warranty of characteristics.

Addendum B: EC-Type Examination Certificate



**BUREAU
VERITAS**



EU - Type Examination Certificate

- (1)
- (2) Equipment and protective systems intended for use in potentially explosive atmospheres – **Directive 2014/34/EU**
- (3) EU - Type Examination Certificate Number
- EPS 11 ATEX 1 333 X** **Revision 2**
- (4) Equipment: GIA 0420 WK - ex, GIA 0420 WKT - ex, GIA 0420 VO - ex, GIA 0420 VOT - ex,
GIA 010 WK - ex, GIA 010 WKT - ex, GIA 010 VO - ex, GIA 010 VOT - ex,
GIA 0420 N - ex, GIA 010 N - ex
- (5) Manufacturer: GHM Messtechnik GmbH
- (6) Address: GHM GROUP - Greisinger
GHM Messtechnik GmbH
Kiebitzhörn 18
22885 Barsbüttel
Germany
- (7) This equipment and any acceptable variation thereto are specified in the annex to this certificate and the documentation therein referred to.
- (8) Bureau Veritas Consumer Products Services Germany GmbH, notified body No. 2004 in accordance with Article 21 given in the Directive 2014/34/EU of the European Parliament and of the Council of 26 February 2014, certifies that this equipment has been found to comply with the essential health and safety requirements relating to the design and construction of equipment and protective systems intended for use in potentially explosive atmospheres, given in Annex II of the Directive. The examination and test results are recorded in the confidential documentation under the reference number 09TH0409.
- (9) Compliance with the essential health and safety requirements has been assured by compliance with:
- EN IEC 60079-0:2018** **EN 60079-11:2012**
- (10) If the sign "X" is placed after the certificate number, it indicates that the equipment is subject to special conditions for safe use specified in the annex to this certificate.
- (11) This EU - Type Examination Certificate relates only to the design and examination of the specified equipment in accordance with Directive 2014/34/EU. Further requirements of this Directive apply to the manufacture of this equipment and its placing on the market. Those requirements are not covered by this certificate.
- (12) The marking of the equipment shall include the following:



II 2G Ex ia/ib IIC/IIB T4 Gb

Certification department of explosion protection

H. Schaffer

Hamburg, 2020-10-02

Page 1 of 3

Certificates without signature and seal are void. This certificate is allowed to be distributed only if not modified. Extracts or modifications must be authorized by Bureau Veritas Consumer Products Services Germany GmbH. EPS 11 ATEX 1 333 X, Revision 2.



BUREAU
VERITAS

Annex

(13)

(14) EU - Type Examination Certificate EPS 11 ATEX 1 333 X

(15) Description of equipment:

The device GIA 0420 ... - ex is an indicator for the electrical standard current signal 4 – 20 mA without auxiliary power supply. The device GIA 010 ... - ex is an electric indicator for the electrical standard voltage signal 0 – 10 V. Both variants have an optional switching output for the connection of suitable relays or signaling devices. The device is manufactured in various versions.

GIA 0420 VOT - ex	Two-wire circuit 4-20 mA, case with adapter for an angle plug for easy connection in between. Push-button accessible from outside
GIA 010 VOT - ex	Three-wire circuit 0-10 V, case and push-button as GIA 0420 VOT - ex.
GIA 0420 VO - ex	Two-wire circuit 4-20 mA, case as GIA 0420 VOT - ex, push-button inside
GIA 010 VO - ex	Three-wire circuit 0-10 V, case as GIA 0420 VOT - ex, push-button inside
GIA 0420 WKT - ex	Two-wire circuit 4-20 mA, case with cable tail, push-button accessible from outside
GIA 010 WKT - ex	Three-wire circuit 0-10 V, case and push-button as GIA 0420 WKT - ex
GIA 0420 WK - ex	Two-wire circuit 4-20 mA, case as GIA 0420 WKT - ex, push-button inside
GIA 010 WK - ex	Three-wire circuit 0-10 V, case as GIA 0420 WKT - ex, push-button inside
GIA 0420 N - ex	Two-wire circuit 4-20 mA, case for installation in switching cabinets, connection via screw and plug terminals
GIA 010 N - ex	Three-wire circuit 0-10 V, case and connection as GIA 0420 N - ex



Revision 2

Page 2 of 3
Certificates without signature and seal are void. This certificate is allowed to be distributed only if not modified. Extracts or modifications must be authorized by Bureau Veritas Consumer Products Services Germany GmbH. EPS 11 ATEX 1 333 X, Revision 2.

BUREAU VERITAS
Consumer Products Services Germany GmbH

Gehleckerweg 40, D-22419 Hamburg
Phone: +49 40 74041-0

cps-hamburg@bureauveritas.com
www.bureauveritas.de/cps



BUREAU
VERITAS



Electrical data:

The device may be connected to approved intrinsically safe circuits with the following maximum values:

GIA 0420 ... - ex	GIA 010 ... - ex
U _i = 28 V DC	U _i = 28 VDC
I _i = 100 mA	I _i = 100 mA
P _i = 1.2 W	P _i = 0.95 W
Inner Kap.: C _i < 13 nF	Inner Kap.: C _i < 26 nF
Inner Ind.: L _i ~ 0 µH	Inner Ind.: L _i ~ 0 µH
U _i , I _i , P _i also apply to the circuit output with C _i < 4.5 nF, L _i ~ 0 µH	

(16) Reference number: 09TH0409

(17) Special conditions for safe use:

For all variants:

For units with optional output switch, the output switch and the switching device must be supplied from the same intrinsically safe circuit as the indicator GIA.

Only approved intrinsically safe switching devices may be used which correspond to the specified maximum values of the circuit. The total capacitance and inductance of the devices GIA ... and the switching devices, including the values, may not exceed the allowable for the intrinsically safe circuit totals. If concentrated inductances and capacitances exist, the manufacturer must be consulted for permission.

Modifications or repairs of the device may not be performed by the customer. For maintenance or repair the device must be sent to the manufacturer.

Especially for the variants VO, VOT and WK, WKT:

The opening of the device is only permitted outside the hazardous area.

The setting of the inner keys (VO, WK) may be performed only by trained personnel.

The devices VO, VOT meet the requirements of intrinsic safety only after angle plugs, which are appropriate to the required IP protection degree, are connected. The devices shall be installed in places that are protected against external damage.

The devices back side (VO, VOT, WK, WKT) may not be cleaned with a cloth or other means, which can generate an electrostatic charge.

Especially for the variant N:

The device GIA ... N - ex meet the requirements of intrinsic safety only after it is built in an appropriate device, which conforms with the necessary IP protection degree.

(18) Essential health and safety requirements:

Met by compliance with standards

Certification department of explosion protection

Hamburg, 2020-10-02



Page 3 of 3
Certificates without signature and seal are void. This certificate is allowed to be distributed only if not modified. Extracts or modifications must be authorized by Bureau Veritas Consumer Products Services Germany GmbH. EPS 11 ATEX 1 333 X, Revision 2.

BUREAU VERITAS
Consumer Products Services Germany GmbH

Gehleckerweg 40, D-22419 Hamburg
Phone: +49 40 74041-0

cps-hamburg@bureauveritas.com
www.bureauveritas.de/cps